

Ref. No.	LGETH -180208-015
Date	Feb. 08. 2018
Rev. No.	Rev.0
Rev. Date	-

LG Electronics Inc.

SPECIFICATION SHEET for APPROVAL

MODEL: GJS189PAA

PRELIMINARY

CUSTOMER: EMBRITAL

APPROVAL			
Name			
Date			
AIR CONDITIONER MODEL			

LG Electronics Inc.

	Designed	Checked	Approved
Name			
Date			

Please read this specification sheet thoroughly before installation or operating.

Please Return 1 Copy on Your Approval.

Air Conditioning Compressor Division LG Electronics Inc.

Tel: (+66)38 - 923 - 109 Fax: (+66)38 - 923 - 119

Ref. No.	LGETH -180208-015
Date	Feb. 08. 2018
Rev. No.	Rev.0
Rev. Date	-

0.Revision History

Date	Rev. No	Rev. description	Write

Ref. No.	LGETH -180208-015
Date	Feb. 08. 2018
Rev. No.	Rev.0
Rev. Date	-

1.Specification

1.1 Compressor


1	Model Name	GJS189PAA
2	Compressor Type	Hermetic Motor Compressor
3	Compression Type	Rotary Type (Rolling Piston Type)
4	Application	Refrigeration system (Cooling & Heating)
5	Refrigerant	R410A
6	Safety Approval	VDE
7	Oil / Oil Charging Amount	POE(RB68A) / 440± 10cc
8	Displacement	18.9 cc. / rev
9	Painting	Black Color Paint
10	Net Weight (Including Oil)	15.5 kg
11	Suction Tube I.D	Ø 12.8 mm
12	Discharge Tube I.D	Ø 9.7 mm

1.2 Motor

Motor Type / Starting Type	Single Phase Induction Motor / PSC	
Pole / Rated Output	2	Pole / 1,300 Watts
Power Source	1 Ph -	220~240 Volts - 50 Hz
Rated Revolution	2,859 rpm	
Insulation Class	E Class	
Windings Resistance	Main	2.21 ± 7% [Ω]
(at 25 °C)	Sub	2.56 ± 7% [Ω]
Locked Rotor Ampere	36 A (at 240 V)	

Ref. No.	LGETH -180208-015
Date	Feb. 08. 2018
Rev. No.	Rev.0
Rev. Date	-

1.3 Wiring diagram

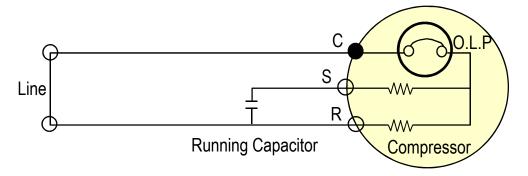

X Make Sure to connect right way same with the wiring diagram.

1.4 Electrical Component

Running Capacitor	45 MFD / 440 VAC
Overload Protector	INTERNAL TYPE

1.5 Performance

Voltage		220V	240V
Cooling Capacity (-5%↑)	[BTU/h]	15,450	15,600
	[W]	4,527	4,571
Power Input (+5%↓)	[Watts]	1,500	1,545
EER (-5%↑)	[BTU/w·hr]	10.3	10.1
	[W/W]	3.02	2.96
Running Current	[A]	7.1	6.9


Rated Conditions (ASHRAE-T Condition)

Return Gas Temp. : 35.0 °C (95 °F) Cond. Temp. : 54.4 °C (130 °F) Liquid Temp. : $46.1 \,^{\circ}\text{C}$ ($115 \,^{\circ}\text{F}$) Ambient Temp. : $35.0 \,^{\circ}\text{C}$ ($95 \,^{\circ}\text{F}$) Evap. Temp. : 7.2 °C (45 °F)

Ref. No.	LGETH -180208-015
Date	Feb. 08. 2018
Rev. No.	Rev.0
Rev. Date	-

1.6 Noise & Vibration

Voltage		At 240 V
Sound Level	[dB(A)]	70 Max
Vibration	[µm]	250 Max

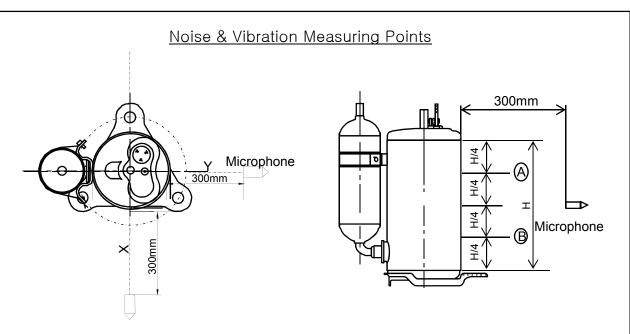

- Measuring points for specification approval
 - Noise : 2 points (X, Y)- Vibration : 2 points (A, B)
- \bullet Compressor vibration is measured by a vibration meter which is contacted compressor $\begin{tabular}{l} \end{tabular}$
- Test Condition :
 - Standard Condition (Ps/Pd = 9.12 / 33.45 kg/cm²G)

Ref. No.	LGETH -180208-015
Date	Feb. 08. 2018
Rev. No.	Rev.0
Rev. Date	-

1.7 Minimum Starting Voltage

Cold Start	
- Temp. Condition: 35°C	187 Volts Max.
- Balanced pressure : Pd – Ps ≤ 0.5 kg f/cm²	
- Balanced pressure : Pd – Ps = 0 kg f/cm²	187 Volts Max.

1.8 Voltage Range

at Standard Condition	198 ~ 264 Volts
at Overload Condition	198 ~ 264 Volts

Test Conditions

	Standard Condition	Overload Condition
Con. Temp (°C)	54.4	63.8
Eva. Temp (°C)	7.2	10.4
Return Gas. Temp (°C)	35.0	25
Ambient Temp (°C)	35.0	43

1.9 Others

Leak Tight Pressure High Pressure Side		32 kgf / cm² G
Low Pressure Side		-
Hydrostatic trength	High Pressure Side	170 kgf / m² G
Pressure	Low Pressure Side	69 kgf / cm² G
Insulation Resistance (with 500V D.C Mega Tester)		50 MΩ Min.
Withstand Voltage		At 2,200 V / 1 Sec. Leakage Current is less than 5 mA
Residual Moisture	e (Karl Fisher Method)	60 mg Max.
* Residual Impurities		70 mg Max
Oil circulation		1.5 wt% ↓

^{*)} Each part was measured separately

Ref. No.	LGETH -180208-015
Date	Feb. 08. 2018
Rev. No.	Rev.0
Rev. Date	-

2.Delivered Parts List

Parts Name	Type (Model)	EA	Parts Dwg. NO.	Sur	oply
raits Name	Type (Woder)	LA	LG	Sul	Эріу
Compressor	GJS189PAA	1	-	YES	NO
O.L.P	INTERNAL TYPE	-	-	YES	NO
Cover, Terminal	-	1	3550U-L005D	YES	NO
Gasket	-	1	4986UHL004A	YES	NO
Nut, Common	-	1	FAD30241201	YES	NO
Washer, Customized	-	1	FAF30240201	YES	NO
Damper, Rubber	-	3	MCQ66473401	YES	NO
Sleeve, Damper	-	-	-	YES	NO
Washer, Plain	-	-	-	YES	NO
Nut, Hexagon	-	-	-	YES	NO
Bolt, Stud	-	-	-	YES	NO
Capacitor	-	-	-	YES	NO
Screw, Earth	M4*0.7 , Length : Max 6 mm.	-	-	YES	NO

 \divideontimes) Refer to Attachments (Accessory Parts Drawings.)


Ref. No.	LGETH -180208-015
Date	Feb. 08. 2018
Rev. No.	Rev.0
Rev. Date	-

3. Operating Limit

3.1 Operation Range

Discharge Pressure	[kgf / cm² G]	42 Max
Suction Pressure	[kgf / m² G]	3 ~ 13
Discharge Temp.	[℃]	110 Max.
Motor Coil Temp.	[℃]	125 Max.



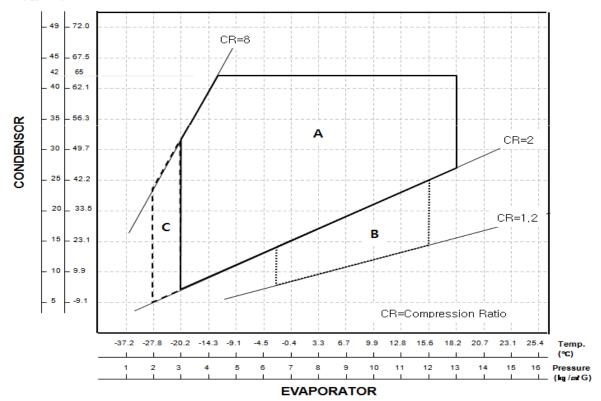

Area A : Normal Operating Zone

Area B : High Density Flow Zone

-During Starting within 3 minutes

Area C : During defrosting & re-starting -Running time within 3 minutes

X This guide contains many important safety messages. Always read and obey all safety messages.

A WARNING You can be killed or seriously injured if you don't follow instructions.

Ref. No.	LGETH -180208-015
Date	Feb. 08. 2018
Rev. No.	Rev.0
Rev. Date	-

3.2 Application Limit

Refrigerant Charge Limit	[WRAC for Cooling Only] 1,650g Max (*K \geq 0.3, **OIL Dilution Rate=0.20) [WRAC for Heat Pump] 1,237g Max (*K \geq 0.4, **OIL Dilution Rate=0.25) [SRAC for Cooling Only] 1,424g Max (*K \geq 0.4, **OIL Dilution Rate=0.20) [SRAC for Heat Pump] 950g Max (*K \geq 0.6, **OIL Dilution Rate=0.25)
Liquid Refrigerant Back	System should be designed not to allow the liquid to go back to compressor which cause knocking noise, current increase or undesirable vibration.
Δ T : Temp. Difference°C	Δ T = Case Bottom Temp Condensing Temp. It must be kept Δ T ≥ 5°C
Pressure Difference in Operating	The Pressure difference in operating shall be 5.0kgf/cm² or more, but 3 minutes starting excluded.
ON/OFF Operation	Each cycle should be at least 6 minutes (ON Time : at least 3 minute , OFF Time : at least 3 minutes)
Pressure Difference at Starting	When starting, discharge pressure is balanced with suction pressure. (Pd – Ps \leq 0.5 kgf/cm 2)
Tilt in Operation	The allowable tilt of the compressor in operation shall be 5° or less.
	The Accumulator volume should be enough to cover 50% of maximum system refrigerant volume.
	Ratio coefficient 'K" should be over 0.6(heating system) or 0.4(cooling syetem)
System Accumulator	, , , , ,
System Accumulator	Syetem) Effective Volume of Accum. × Specific gravity of Refrigerant * K =
System Accumulator	Syetem) Effective Volume of Accum. × Specific gravity of Refrigerant * K =
System Accumulator Protecting Reverse Operation	Syetem) Effective Volume of Accum. × Specific gravity of Refrigerant * K =

▲ WARNING

Ref. No.	LGETH -180208-015
Date	Feb. 08. 2018
Rev. No.	Rev.0
Rev. Date	-

3.2 Application Limit

Frequency Range	Rated Frequency ±2%
Pipe Stress	Don't allow any force on discharge & suction pipe . The piping stress must be less than 300kgf/cm² at starting and stopping. And less than 153kgf/cm² at running.
Oil Level	It must be checked oil level by the compressor with sight glass we supply. And oil level must be kept over guide line level **note 2. at any condition.
Protection device	Refrigeration system must has the compressor protection device like over pressure, high temperature, sensing locked pump in the controller. When starting & running fail by abnormal overload, controller must be able to cut off power of compressor before motor burn out.
Pump down refrigerant	If pump down time is too long, compressor can be damaged due to excessive temperature increase or poor lubrication. Guideline of pump down process. - Time: less than 30 seconds - Suction Pressure: It should not run under below 1kgf/cm²G. And before closing a service valve, compressor running for more than 5 minutes is recommended.

If gas charge amount of refrigerant specified is exceeded,
 both parties should discuss the matter to determine compressor specification.
 (accumulator volume, lubricating oil amount) and system specifications (crank case heater, oil separator, additional accumulator, etc)

* Effective Period of This Document *

This document will be effective after LG's receipt with your authorized signature. When design modification is approved by the customer , the current document is unavailable.

▲ WARNING

Ref. No.	LGETH -180208-015
Date	Feb. 08. 2018
Rev. No.	Rev.0
Rev. Date	-

3.3 Process Limit

Use defined Refrigerant and oil	Any process in where the HCFC's refrigerant or the different kind of oil against the defined. Compressor oil are mixed should be avoided.
Avoid Damage running	The running operation that inspection and the protector inspection that affect a damage to the function and durability of the compressor should be avoided
Running dummy indoor	When the outdoor unit is operated with the indoor dummy unit, the discharged oil should be recovered enough
Prevent oxidation in pipe	Always purge the system and the compressor with the dry nitrogen in order to prevent oxidation of the piping
Charging Refrigerant	When charging refrigerant into the cycle, make sure that refrigerant always be filled from the higher pressure side (condenser exit) of the cycle. If liquid refrigerant is sucked in to the compressor liquid compression occurs, The discharge valve is damaged, lubrication effectiveness degenerates and reliability drops noticeably
Avoid Vacuum running	Do not operate the compressor in a vacuum state. Furthermore do not apply high voltage to a vacuum state compressor. There is a danger that insulation could degenerate, causing electric shock
Avoid Air compression	Do not compress the air including the case of leakage in the refrigeration cycle. If compressors run with air mixed, inside the compressor is heated and pressurized, which may cause an explosion
Promptly Assemble compressor in line	After removing rubber plugs from compressor tubes, Promptly use the compressor. And do not leave in the atmosphere for 10 minutes over. If Air gets into the compressor, accelerating degeneration of the inside of the cycle or compressor
Wiring	Wires connected to the compressor, follow the compressor specification manual and instructions
Storage temperature	-10°C ~ 65°C
Earth connection	Use compressor with grounded system only.

Ref. No.	LGETH -180208-015
Date	Feb. 08. 2018
Rev. No.	Rev.0
Rev. Date	-

** Note 1. OIL Dilution rate

Oil Weight

----- ≈ 0.25(Heating) or 0.20(Cooling)


Refrigerant Weight + Oil Weight

※ Specific Gravity of POE(RB68A)= 0.94 (at 20°C)

[Unit]

○ Oil Weight : [g]○ Refrigerant Weight : [g]

** Note 2. Oil Level Guide Line

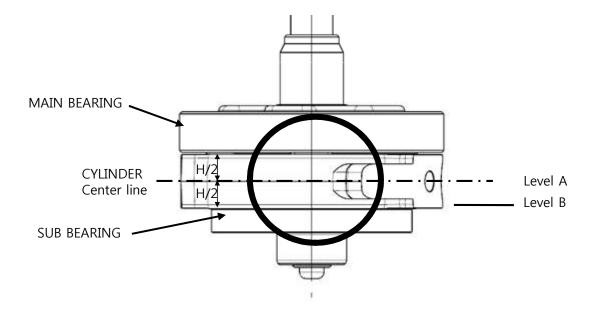

Over Level A: Steady state at any condition.

Over Level B: Minimum level of transition period within 3minutes

Ref. No.	LGETH -180208-015
Date	Feb. 08. 2018
Rev. No.	Rev.0
Rev. Date	-

* LABEL *

[UNIT: mm]



All safety messages will identify the hazard, tell you how to reduce the chance of injury, and tell you what can happen if the instructions are not followed. You are strongly advised to follow these safety instructions.



This is the Safety alert symbol. It indicates a hazardous situation which, if not avoided, could result in death or serious injury.



This is the Electric shock hazard symbol. It indicates a hazardous situation which, if not avoided, could result in the electric shock.



This is the Getting burnt symbol. It indicates a hazardous situation which, if not avoided, could cause fire.



This is the Explosion or Fire symbol. . It indicates a hazardous situation which, if not avoided, could cause explosion or fire.

*1. Effective Period of This Document *

This document will be effective after LG's receipt with your authorized signature. When design modification is approved by the customer , the current document is unavailable.

*2. Compressor operating range *

The Compressor can operate within the limits of the outlined area. Outside these operating fields, the system cause early defects in the compressor. The compressor defects caused by applications operating outside the outlined area will not be considered under the warranty. If the appliance be operated out of the operating range, it must be agreed with the supplier.

Attachment


PAGE

1. Compressor Drawing : A-1


2. Accessory Fitting : A-2


3. Part Drawings. : A-3 ~ A-7

5. Guideline for using R410A: A-8

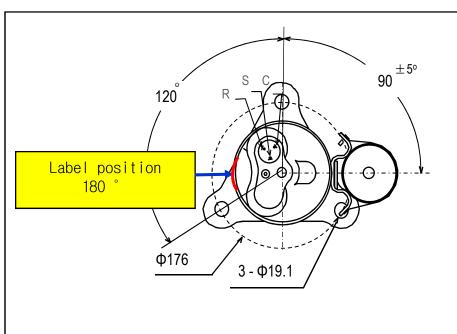


Ref. No.	LGETH -180208-015
Date	Feb. 08. 2018
Rev. No.	Rev.0
Rev. Date	-





Detail of Discharge Tube

Detail of Suction Tube

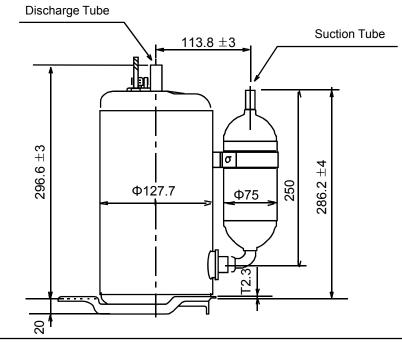


NOTES


1. PAINTING: BLACK PAINT (ELECTRO DEPOSITION)

2. OIL : POE(RB68A) 440 cc CHARGED3. NITROGEN CHARGED AFTER DEHYDRATION

	ALE N/S
COMP. OUT LINE	HF. ENGR.
C 10400DA	eb. 08. 2018 MORNCHAI T.
GJS189PA	CUSTOMER EMBRITAL

Accessory Fitting

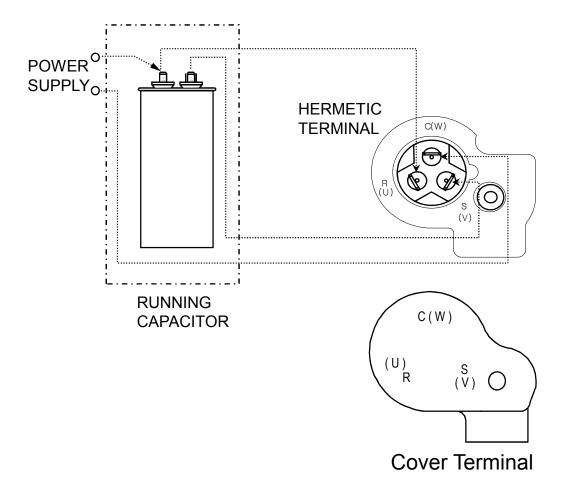

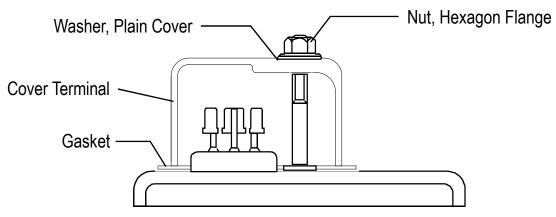



C,S,R mark embossed on cover terminal Nut assembly torque should be below 20 kgfcm.


Cover, Terminal

Drawing No. 3550U-L005D

(UNIT:mm)








MATERIAL	COLOR	REMARK
Lupox TE-5006F (polybutylene terephthalate)	BLACK	MARKS(C(W),R(U),S(V))

Gasket

Drawing No. 4986UHL004A

(UNIT:mm)

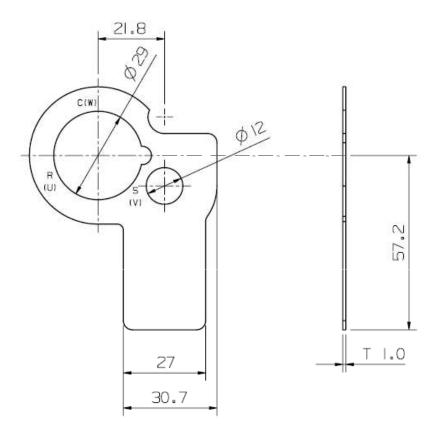


MATERIAL	REMARK
SILICONE	MARKS(C(W),R(U),S(V))

Nut, Common

Drawing No. FAD30241201

(UNIT:mm)

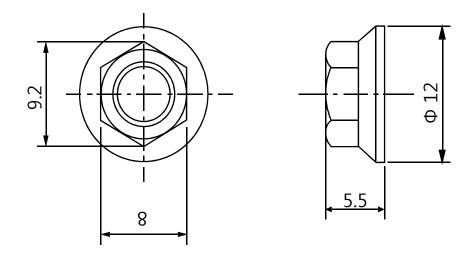



* MATERIAL: STEEL (ELECTRIC PLATING OF ZINC)

Washer, Customized

Drawing No. FAF30240201

(UNIT:mm)

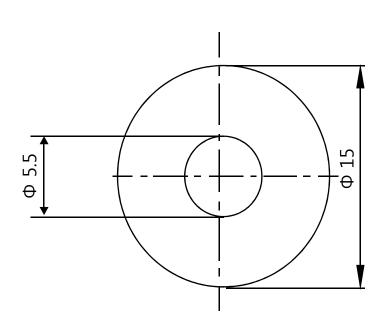





* MATERIAL : POLYAMIDE (NYLON)

Damper, Rubber

Drawing NO. MCQ66473401

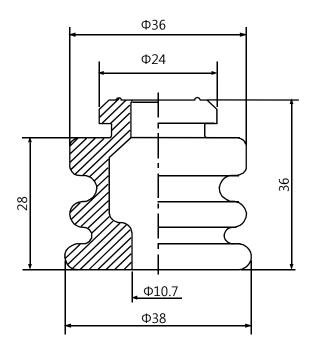

* MATERIAL : NATURAL RUBBER

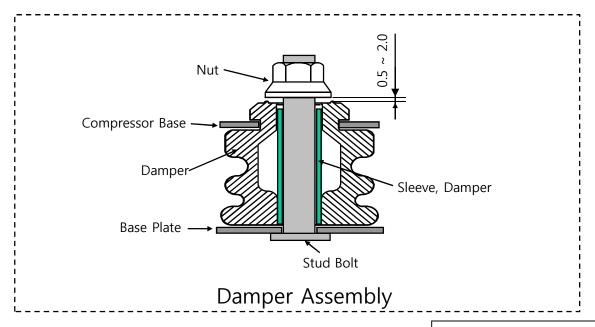

LG Electronics Inc.

Guideline of using R410A

Process Control

1. Residual Moisture

Moisture control of lubricant is very important, because hydrolysis of lubricant causes many problems.

2. Residual Chlorine

Chloric furuoro carbon and solvent cause decomposition of oil, no chlorine is recommended (if impossible, below 100 ppm)

3. Contamination Control

Contamination accelerate wear of compressor parts and decomposition of oil. Therefore contamination control must be required.

4. Compressor Sealing

It is recommended to assemble compressor within **5 minutes** after removing sealing cap of compressor.

5. Tube Connection

When brazing welding for tube connection, no use of Flux is recommendable.

■ Facilities

1. Vacuum Pump

Below 0.5 torr vacuum rate is recommendable.

2. Charging System

An exclusive charging equipment is necessary.